



# Certificate of Accreditation

## Sewage Management Facility

### Sewage Ejection Pump Station

*This Certificate of Accreditation is issued by the Secretary of the NSW Ministry of Health pursuant to Clause 41(1) of the Local Government (General) Regulation 2005.*

**Manufacturer:** *Neatport Pty Ltd TA Suncoast Waste Water Management*

**Of:** *59 Industrial Ave, Kunda Park, QLD, 4556*

*The Ozzi Kleen Models of Sewage Ejection Pump Stations as described in the following Schedule have been accredited as sewage management facilities for use in single domestic premises in NSW.*

*Director, Environmental Health  
for Secretary (delegation PH335)*

**Issued:** *6 August 2019*

**Certificate No:** *SEPS008*

**Expires:** *31 December 2023*



## **Accreditation Schedule**

*The Certificate of Accreditation applies to the following sewage ejection pump stations.*



*The following Ozzi Kleen models of Roto moulded polyethylene sewage ejection pump stations of:*

- *Model PSS1000 of 1000L nominal capacity, flat or hopper base, with a single pump*
- *Model PSS1500 of 1500L nominal capacity, flat or hopper base, with a single pump*
- *Model PSS4000 of 4000L nominal capacity, flat or hopper base with dual pumps*

*Each Model consists of:*

- *A vertical axis type cylindrical rotational moulded polyethylene pump well and lid, manufactured to AS1546.1:2008.*
- *A single or dual Bianco PUMPZBIA-PDG150M positive displacement grinder pump (or equivalent), fitted with water level and high water level floats.*
- *A check valve and gate valve fitted on the outlet of the grinder pump. The discharge pipe is connected to a 32mm or 40mm diameter uPVC or poly pipe to the sewer.*
- *An audible and visible alarm with mute facility.*

**ACCREDITED**  
 - 6 AUG 2019  
 NSW MINISTRY OF HEALTH

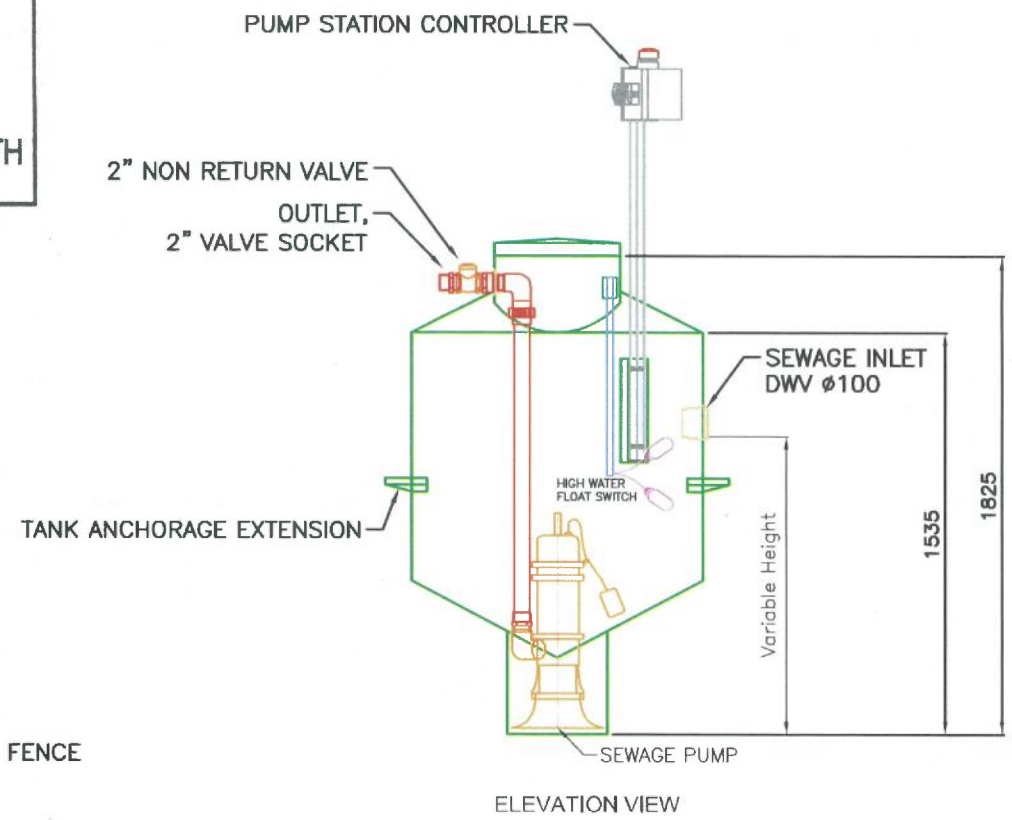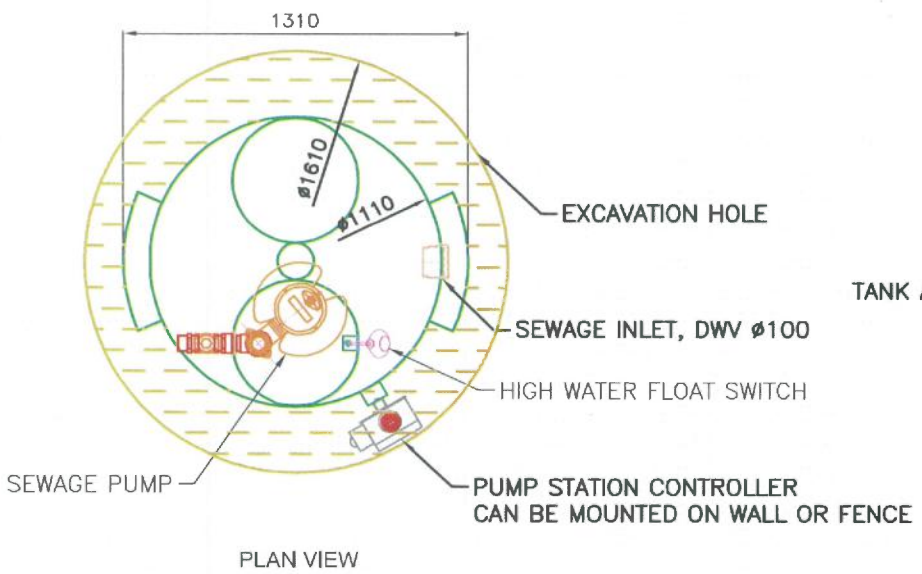

DATE	DESCRIPTION	REV.	BY
21/04/17	GENERAL REVISION	1	YH





Suncoast Waste Water Management

59 INDUSTRIAL AVE  
 KUNDA PARK  
 QLD 4556  
 PH +61 7 5459 4900  
 FAX +61 7 5456 4677  
 www.ozzicleen.com

CLIENT	GENERAL	DESIGN	AP
PROJECT	PRESSURE SEWER SYSTEM PSS1000	DRAWN	YH
TITLE	GENERAL LAYOUT	CHKD	AP
DWG NO.	GD-PSS1000_SP-H10	DATE	21/04/17
		SCALE	NTS

**ACCREDITED**  
 - 6 AUG 2019  
 NSW MINISTRY OF HEALTH

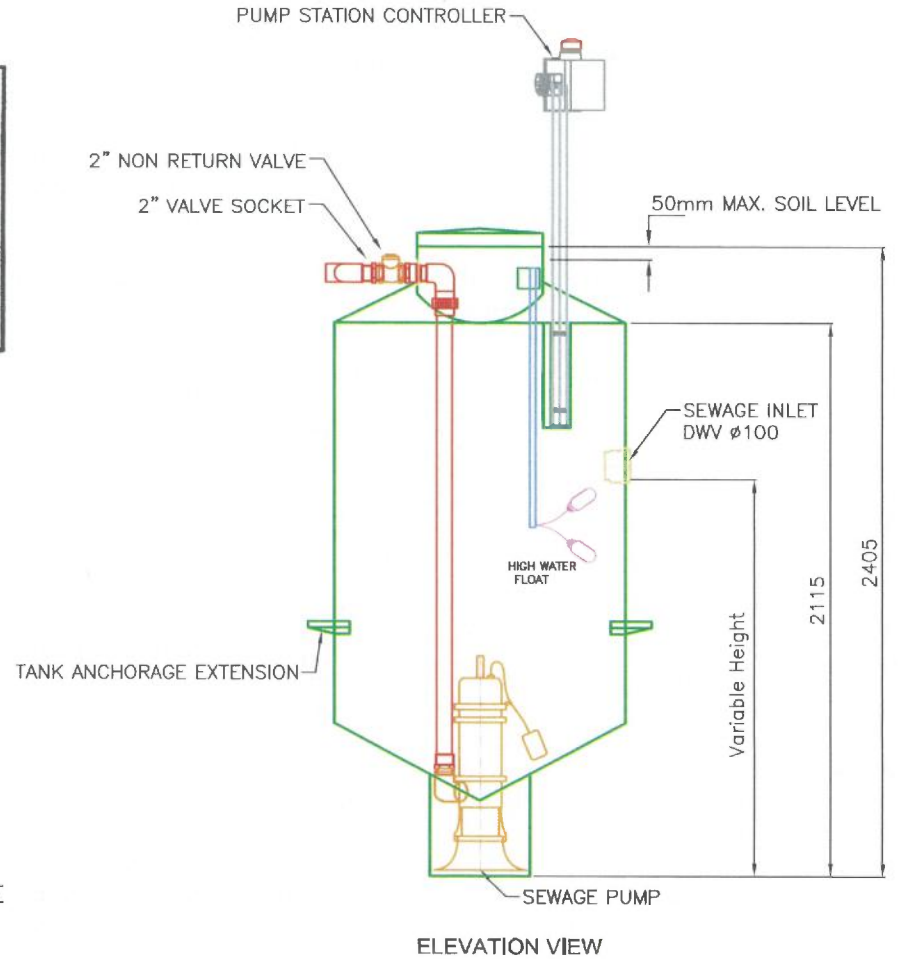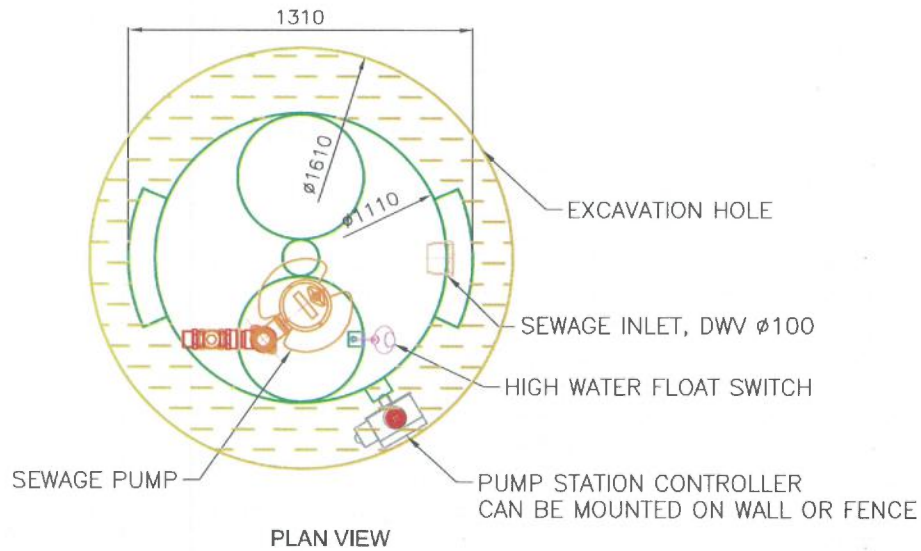

DATE	DESCRIPTION	REV.	BY
25/07/19	GENERAL REVISION	2	YH
21/04/17	GENERAL REVISION	1	YH




59 INDUSTRIAL AVE  
 KUNDA PARK  
 QLD 4556  
 PH +61 7 5459 4900  
 FAX +61 7 5458 4677  
 www.ozziclean.com

Suncoast Waste Water Management


CLIENT	GENERAL	DESIGN	AP
PROJECT	PRESSURE SEWER SYSTEM PSS1500	DRAWN	YH
TITLE	GENERAL LAYOUT	CHKD	AP
DWG NO.	GD-PSS1500_SP-H10	DATE	25/07/19
		SCALE	NTS



**ACCREDITED**  
 - 6 AUG 2019  
 NSW MINISTRY OF HEALTH

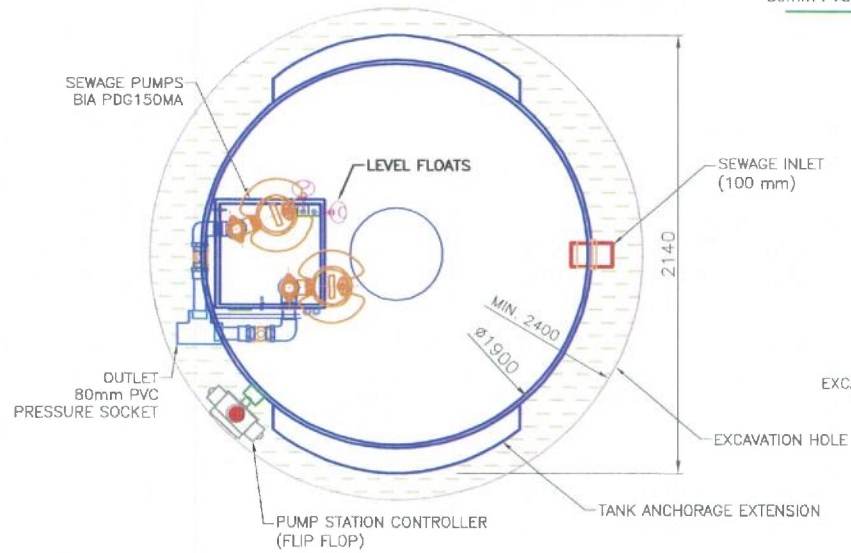

PLAN

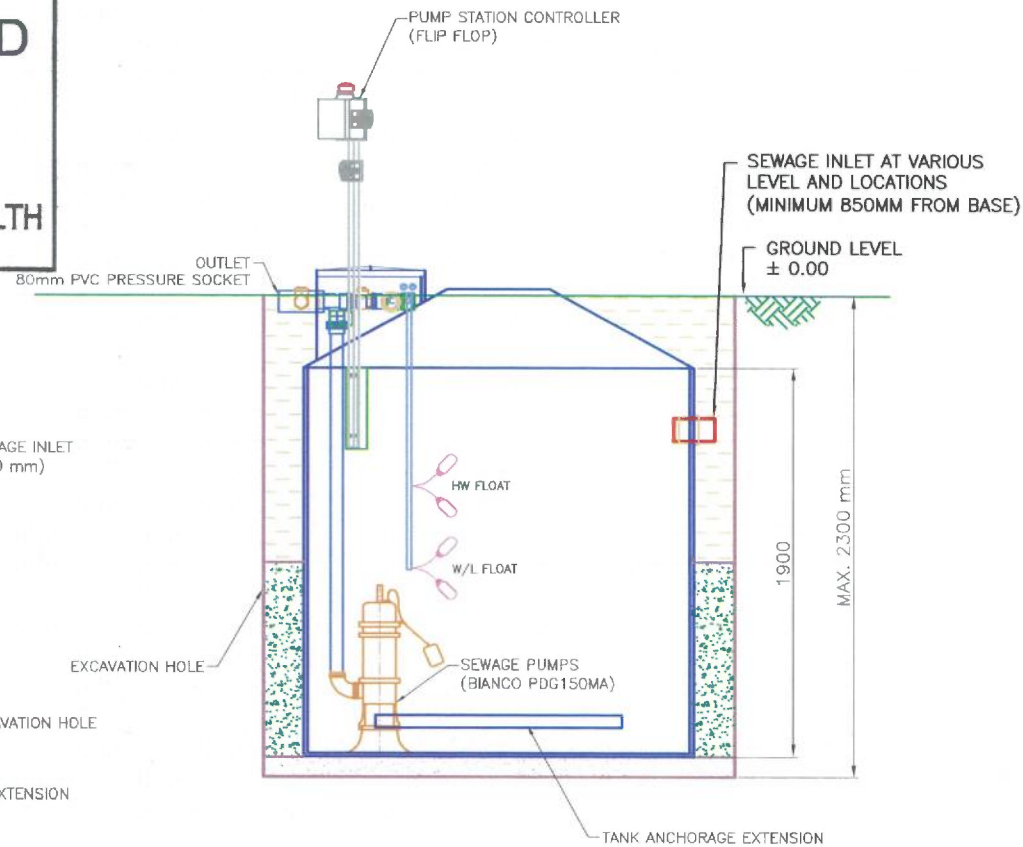

ELEVATION

DATE	DESCRIPTION	REV.	BY
06/04/18	GENERAL REVISION	1	YH



Suncoast Waste Water Management

59 INDUSTRIAL AVE  
 KUNDA PARK  
 QLD 4556  
 PH +61 7 5459 4900  
 FAX +61 7 5456 4677  
 www.ozzikleen.com

CLIENT	GENERAL	DESIGN	AP
PROJECT	PSS4000 Pressure Sewer System	DRAWN	YH
TITLE	GENERAL LAYOUT	CHKD	AP
DWG NO.	GD-PSS4000_FF-H10	DATE	06/04/18
		SCALE	NTS